



Das Fachmedium der TGA-Branche

Das TGA-Online Portal
www.tab.de



Organ des BTGA 

Special print

Calculation of Evaporative Cooling –
Potential and limitations of indirect evaporative cooling



Calculation of Evaporative Cooling

Potential and limitations of indirect evaporative cooling



In central HVAC systems, cooling systems based on indirect evaporative cooling are becoming increasingly important. Experts say that in Germany approximately 10% of the roughly 25,000 new HVAC systems produced each year are equipped with this environmentally friendly cooling technology, and that this trend is increasing. Using a free calculation tool, expert planners and plant engineers can very easily determine the energy-related and environmental benefits as well as the real performance scores and seasonal performance factors of evaporative cooling for individual projects down to the decimal point.

Frank Benndorf
Distribution Condair GmbH RC West

To date, the cooling and dehumidification of warm outside air to supply air levels in central HVAC systems has usually been carried out through the operation of mechanical water cooling units that work with synthetic cooling agents. The aim of indirect evaporative cooling consists in taking on the largest possible proportion of this cooling task through the use of evaporated water and thus reducing the load on the cold water unit. As a result, electrical energy consumption and CO₂ emissions are reduced and cooling agent emissions that are damaging to the environment from

The principle of indirect evaporative cooling

In indirect evaporative cooling, the exhaust air removed from the building is humidified as closely as possible to the 100% saturation point. In the process, the air is cooled by 2.5 K per g of water absorbed per kg of air. The exhaust air that has been cooled by approx. 8 to 10 K then flows through heat recovery in the HVAC system and can then absorb a significantly greater amount of heat from the warm outside air (picture 1).

As a result, following heat recovery in the cooler of the water cooling unit, the outside air requires far less aftercooling to reach a desired supply air temperature of, e.g., 19°C. In many cases, evaporative cooling can substitute over 50% of the cold work that would otherwise have to be mechanically produced during the cooling period and result in significant operating cost savings. This will be shown in the examples to follow.

Evaporative cooling performance

The performance capacity of an evaporative cooling depends on many influencing variables. These include the following parameters:

In indirect evaporative cooling, the exhaust air is intensively humidified and thereby cooled down by 8 to 10K on average. This cool exhaust air can then extract far more heat from the outside air during the subsequent heat recovery.

1

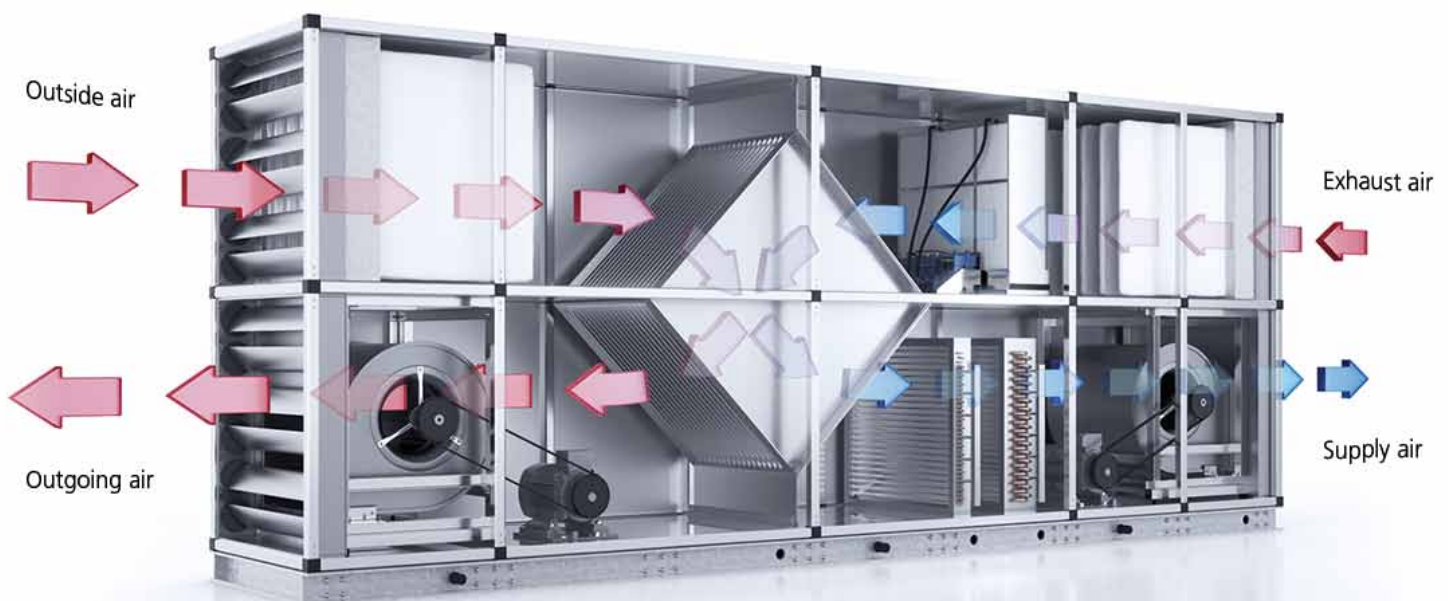


Table 1: Overview of simulation results for various sites
(EVC = evaporative cooling; basis for calculation: normal Summer [average values for 10 years])

German sites		Mannheim	Potsdam	Mühdorf	Essen	Rostock	Fichtelberg
Operation _{total}	h/a	3,120					
Operation _{EVC}	h/a	755	631	568	462	368	81
Cold work _{total}	kWh/a	46,185	40,756	34,036	27,387	16,789	2,100
Cold work _{EVC}	kWh/a	22,453 (49%)	18,076 (44%)	15,929 (47%)	12,750 (47%)	8,334 (51%)	1,634 (78%)
Seasonal performance factor		7.0	7.4	5.7	4.6	3.0	0.9
European sites		Paris	London	Zürich	Vienna	Budapest	Madrid
Operation _{total}	h/a	3,120					
Cold work _{total}	h/a	732	635	564	906	1,063	1,172
Cold work _{EVC}	kWh/a	38,161	27,061	29,913	53,680	71,570	90,495
Cold work _{EVC}	kWh/a	19,387 (51%)	14,679 (54%)	16,228 (54%)	25,690 (48%)	35,846 (50%)	56,866
Seasonal performance factor		6.1	5.2	5.1	9.1	12.7	15.9
Worldwide sites		Moscow	Chicago	Denver	Las Vegas	Colombo	Riyadh
Operation _{total}	h/a	3,120					
Cold work _{total}	h/a	539	1,137	1,137	1,133	3,120	2,636
Cold work _{EVC}	kWh/a	34,425	125,981	85,454	68,764	834,492	381,427
Cold work _{EVC}	kWh/a	12,845 (37%)	35,458 (29%)	60,427 (71%)	51,211 (75%)	80,516 (10%)	196,874 (51%)
Seasonal performance factor		5.3	9.9	14.1	13.1	17.2	42.2

Source: Fotolia

Quality of humidification

For a maximum cooling effect, the exhaust air should be humidified as closely as possible to 100 % relative humidity. Good systems, such as the “ME” by Condair GmbH, Garching, reach values of up to 97 % (picture 2).

Efficiency of heat recovery

The more efficient the heat recovery in the HVAC system is (heat recovery rate ϕ), the more heat the exhaust air that has been cooled in evaporative cooling can extract from the warm outside air. The environmental design directive for HVAC systems, in force since 2016, has a positive impact in this regard: Depending on the model of heat recovery, it demands good heat recovery rates of at least 63 % for HVAC systems.

Influence of exhaust air condition

The drier the exhaust air is, the more heavily it can be humidified and cooled. Using evaporative cooling, exhaust air at a temperature between 24 und 28° C and humidity of 95 % RH can be cooled down by approx. 9 K (exhaust air humidity 30 %) or approx. 5 K (exhaust air humidity 60 %). The drier the exhaust air is, the higher the evaporative cooling performance.

Influence of outside air condition

The greater the difference between the outside air temperature and the exhaust air temperature, and the better the heat recovery rate of the heat recovery, the more heat the cool exhaust air can extract from the warm outside air. If the exhaust air has a temperature of 18° C after evaporative cooling, for example,

it can cool outside air at a temperature of 32° C by between approx. 9 K (heat recovery rate 0.65) and 11.5 K (heat recovery rate 0.80).

Other advantages of evaporative cooling

Mechanical cold water units that are used for HVAC systems need approx. 1 kWh electrical work per 3 to 4 kWh cold work to produce cold water. In Germany, each kWh of electricity is loaded with approx. 0.5 kg CO₂ (electricity mixture factors made up of nuclear power, power stations and regenerative energies). If the electrical work of water cooling units is reduced by evaporative cooling systems, CO₂ emissions are also avoided as a result.

An additional environmental effect comes into the equation. A water cooling unit requires 1 kg of cooling agent in its cooling cycle for every 3 to 4 kW of cooling performance. As soon

as this quantity of cooling agent is leaked into the environment from the cooling cycle through low-quantity leakages, this corresponds to environmental damage of approx. 1,400 to 2,100 kg CO₂ (based on present-day cooling agents). Cold water units have leak rates of approx. 4 to 5 % of the fill volume per year. If due to evaporative cooling systems the chillers can be made in smaller sizes and operated using lower quantities of cooling agent, cooling agent emissions that contribute to the greenhouse effect will also be reduced.

In the EEWärmeG (Renewable Energies Heat Act), all heating and cooling currents that pass from exhaust air to supply air during the heat recovery of a HVAC system are considered regenerative energies and can be credited against the EEWärmeG balance sheet. This also applies to the cold work generated by an evaporative cooling.

2



Calculation of Evaporative Cooling

As the previous explanations have shown, the calculation of the performance and the actually achievable cold work of an evaporative cooling system depends on many parameters. The calculations become even more complex if site, project and operationally-specific aspects, especially the outside air with regard to temperature, humidity and enthalpy throughout the year, are to be taken into consideration. Condair (www.condair.de) has integrated all these factors into the very high-performance and user-friendly "myCoolblue" calculation tool. This tool, which is available free of charge as an app (see link at www.tab.de under "Service" tab in Download section) is based on three steps:

Step 1

Comprises entering the project site and all required operational data (usage times, target temperature and humidity values). The trends over the course of the year of outside temperatures and enthalpies for 15 German

climatic regions and over 300 international cities are saved in the app. These can be selected from a map of the world or a menu. The specifications of the standard design conditions are based on VDI (Association of German Engineers) 4710 (t,x correlations) and on Meteonorm weather data.

Step 2

Relates to the input of the system data. These are the air volume current, the forecast measurements of the HVAC system, the heat recovery system, effectiveness grade and pressure increases of the ventilators and the component layout in the HVAC system.

Step 3

Rapidly calculates the results on the basis of this data and displays these as absolute values or in a graphic. The results are, for example, the necessary nominal performance of the cooling generator with and without taking into consideration evaporative cooling, the annual runtime of the evaporative cooling and the total yearly cold work for air cooling with the proportions of the water

In the "Condair ME" system, processed water is piped upwards to the humidification unit in exact doses and flows slowly downward to the wavelike evaporation bodies. As a result, the exhaust air current is humidified almost to saturation and thus exerts a cooling effect in line with the adiabatic humidification process.

cooling unit, evaporative cooling and heat recovery (regenerative proportion). The results can in turn be calculated for three cases:

Case 1: An annual simulation for normal Summer (average values for 10 years) for the average anticipated energetic contribution of the evaporative cooling and the evaluation of cost-effectiveness. In this case, it should be ensured that the results represent an average value for the period under observation and thus present a "synthetic" annual trend.

Case 2: A annual simulation with an extremely warm Summer for sizing the evaporative cooling and cold water generator to cover the maximum potential cooling requirement. In this case, a year within the observation period with particularly warm Summer temperatures is selected and thus corresponds to the foreseeable extreme values which should be taken into consideration in the case of sensitive requirements.

Case 3: Performance sizing is only carried out in the presence of standard outside conditions in accordance with VDI 4710 or comparable design conditions on the basis of Meteonorm weather data, but without annual simulation.

A seasonal performance factor is also shown in the results. This is the result of the relationship between the cold work generated by the evaporative cooling and the pump work required for the evaporation water and the ventilator work to overcome the air-side loss of pressure of the evaporative cooling system.


Based on the data, a PDF file is generated that can be printed out for the project or sent by email. Using the app, it takes only a few seconds to calculate and represent several variants, e.g. a change of air volume currents, temperatures, type of heat recovery, effectiveness grade of the ventilators, layout of components in the HVAC system, maximum permissible humidity in the area or on the site.

Thus, the simulation results of the app offer an optimum basis for obtaining realistic calculations and estimations of the potential and performance of evaporative cooling, that can often vary significantly between one project and another.

Calculation examples

Several example calculations are carried out below to estimate the cooling cost savings of an evaporative cooling using the "myCoolblue" app. The following operating conditions are specified for a sample project (office building):

- Air volume current 27,000 m³/h (= 7.5 m³/s)
- System cross section W 2,250 x H 1,750 mm
- Air speed 1.9 m/s
- Supply air temperature 18 ... 20°C
- Target area temperature / Summer compensation 22 ... 26°C
- Area air humidity up to a maximum of 65 %
- Heat recovery rate of heat recovery 70 %
- Operation of HVAC system 12 h/day, 5 days/week (= 3,120 h/a)

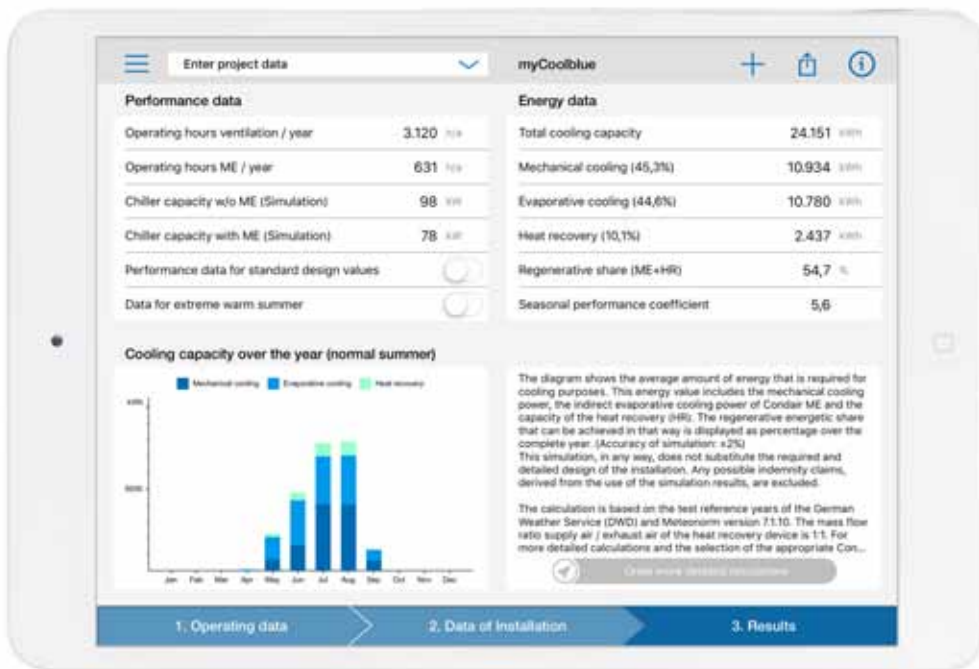

Results of a calculation for evaporative cooling based on “myCoolblue” app as screenshot

Summary

Evaporative cooling technology offers significant potential for reducing the performance of the electrically operated cold water units that have, in many areas, been used almost exclusively for air cooling to date. The evaporation of water in the exhaust air current of a HVAC system means cooling performance is generated with hardly any electricity. From an energy perspective, indirect evaporative cooling can demonstrate its potential particularly well if the following conditions are fulfilled:

- highly effective humidification of evaporative cooling;
- high heat recovery rate of heat recovery;
- low humidity of exhaust air;
- dry sites that are warm in the Summer.

To clarify the performance of the evaporative cooling, this project is positioned at various German and international sites with hot, cool, humid and dry climates. These variations of the site and the output of the corresponding results take only a few seconds using the app.

The values in table 1 show several key tendencies for evaporative cooling:

At moderate and warm sites (Mannheim, Potsdam, Essen, Rostock), the evaporative cooling delivers between 44 and 51 % of the required annual cold work for air cooling. At the cool Fichtelberg site, although the percentage proportion of 78 % is higher, the absolute value of the cold work required in the first place is very low.

At sites which are rather dry, but hot in Summer (Madrid, Riyadh, Las Vegas), the evaporative cooling reaches values of 52 to 75 % of the annual cold work — at high to very high seasonal performance factors. However, this trend declines the more humid the site becomes (Chicago, Colombo): Here, the proportion of evaporative cooling on the annual cold work is only between 10 and 29 %. However, at tropical sites such as Colombo, the evaporative cooling remains operational all year round. Here, the evaporative cooling takes on the task of pre-cooling the outside air. In order to then condition to the required air humidity and supply air temperature (especially dehumidification!), the mechanical cooling machines must deliver high performance at low water flow temperatures.

The cost effectiveness of an evaporative cooling

Besides the many environmental benefits of an indirect evaporative cooling, the cost effectiveness of such a cooling solution also plays an important role. Any additional costs incurred in the purchase should be re-compensated by the savings made on operating costs compared to mechanical cooling systems. Based on the previously explained very many site-specific and operationally-dependent

factors, each air conditioning and cooling project should be inspected individually with regard to the cost effectiveness of the evaporative cooling. In this regard, beyond the parameters described above, the actual project-specific electricity and water expenses also play a key role. As a general rule, however, the evaporative cooling should not be regarded independently, rather as a combined system together with heat recovery, since without this, the adoption of indirect evaporative cooling is physically impossible. The amortization period of the combination with the heat recovery is extended by an insignificant amount through the use of the evaporative cooling. Therefore, the bandwidth of possible amortization periods is large and should be determined for each project individually. Manufacturers of evaporative cooling systems offer customers such cost effectiveness calculations. However, possible variations in design can also be run through and calculated from an energy viewpoint in advance using the simulation app.

However, evaporative cooling is not intended to take on building cooling single-handedly. Only in very few projects, e.g. at sites that are cool in the Summer, is it capable of fully replacing a water cooling unit. Therefore, the evaporative cooling should be regarded mainly as a basic environmental system for pre-cooling of the outside air. The cold water unit, of which a lower-performance and therefore cheaper model can then be selected, takes over the residual or peak load. Evaporative cooling means that in almost all projects, significant savings can be made in cold work to be carried out in a conventional manner. In some cases, under an acceptance of physical limitations, a simple evaporative cooling can even be used, making mechanical cooling systems completely unnecessary.